
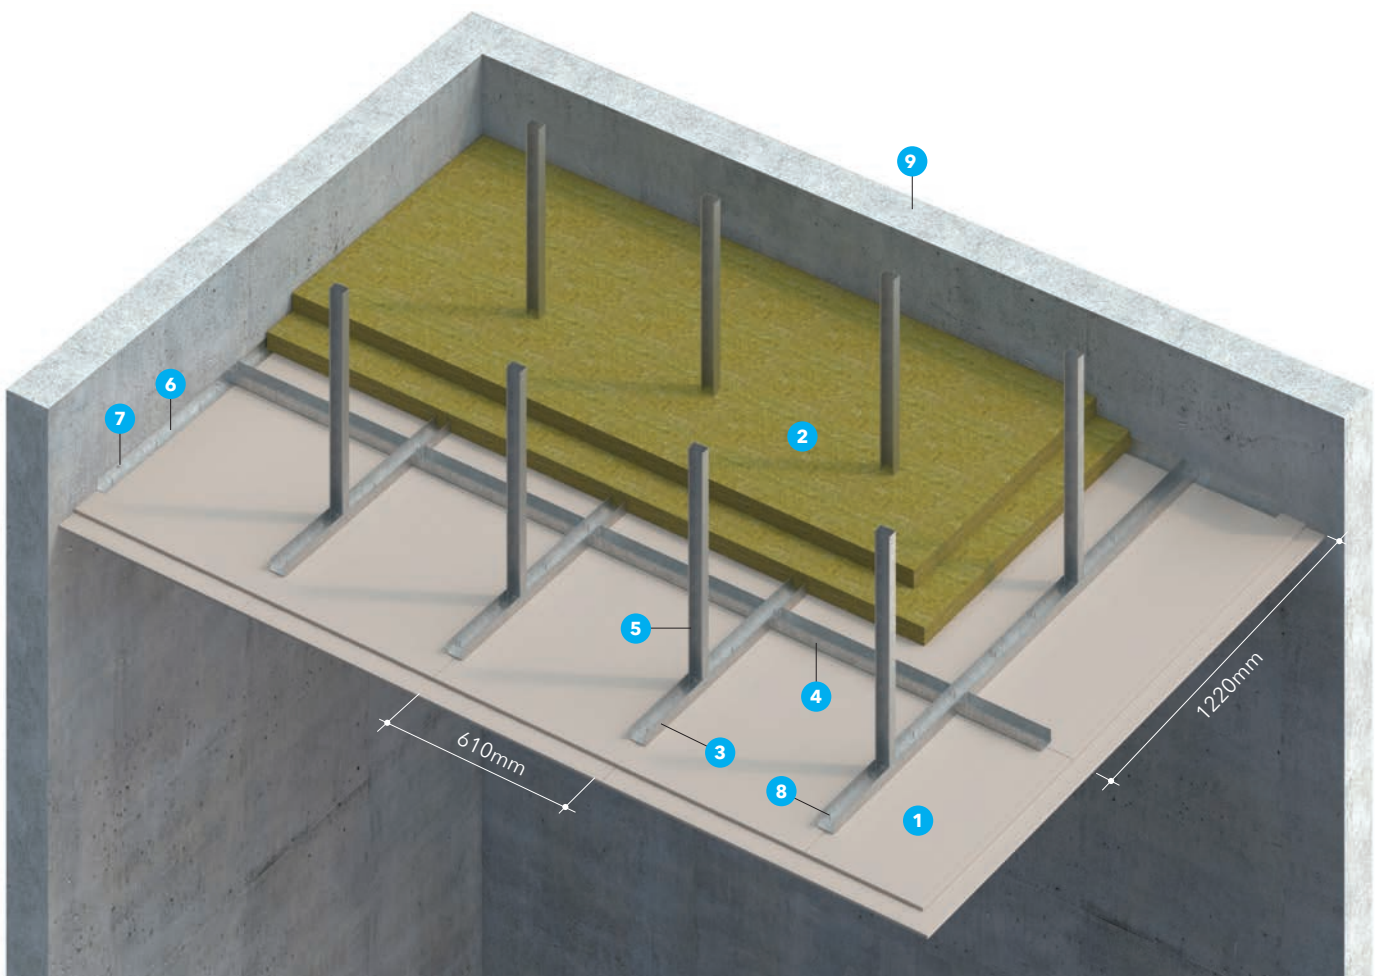


PROMATECT®-H 2-hour fire rated suspended ceiling

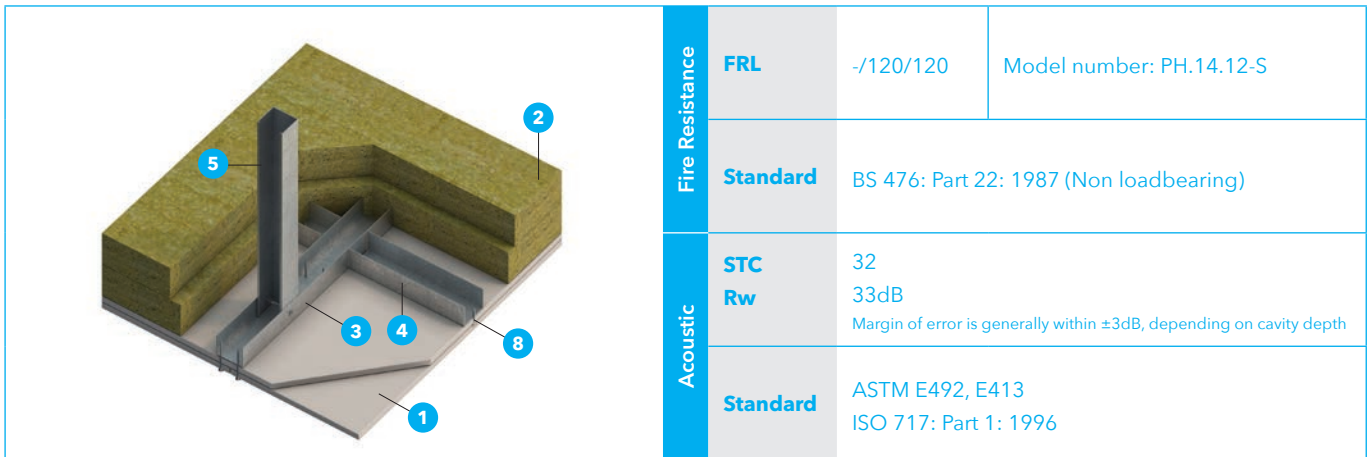

1. Two layers of PROMATECT®-H 9mm thick staggered joints min. 300mm apart between boards.
2. Mineral wool, 2 x 50mm x 100kg/m³ staggered joints min. 300mm apart between mineral wool.
3. Main support C-channel 50 x 31 x 0.6mm at 610mm intervals & at all board joints.
4. Cross support C-channel 50 x 31 x 0.6mm at 1220mm intervals & at all board joints.
5. Steel suspended members at 1220mm intervals. Stress shall not exceed 3.3N/mm.
6. Perimeter angle L30 x 30 x 0.6mm.
7. M6 steel anchor bolts at 500mm centres.
8. M4 self-tapping screws at 200mm centres.
9. Masonry wall.